



**CITY OF CAPE TOWN
ISIXEKO SASEKAPA
STAD KAAPSTAD**

Contact Person:
Kontakpersoon:
Umntu woqhagamshelwano:

**DEPOT MANAGER: Noogh Dramat
021 400 4649**

Telephone No:
Telefoon No.:
Umnxeba:

**CALL CENTRE: 0860 103 089
Ref: 6390/2022 – DbnS/sh**

**INTERRUPTION TO ELECTRICITY SUPPLY
ONDERBREKING IN ELEKTRISITEITSTOEVOER
UPHAZAMISEKO KUBONELELO NGOMBANE**

The electricity supply to:
Die elektrisiteitstoevoer na:
Ubonelelo ngombane kwezi ndawo:

**GIBSON SS, Gibson, Abingdon, Marlo, Sheerness
and Blackheath Roads, Bolus Ave, Ascot Rd,
KENILWORTH**

Will be interrupted on:
Sal onderbreek word op:
Luzakuphazamiseka ngomhla:

TUESDAY: April 26, 2022

From:
Vanaf:
Ukususela:

09h00

To:
Tot:
Ukuya:

16h00

The interruption is required for:
Die onderbreking is nodig vir:
Olu phazamiseko luyimfuneko ukuze:

**MEDIUM VOLTAGE: switchgear
maintenance**

Customers are advised to treat all electricity installations as live for the full duration of the interruption as the electricity supply may be restored at any time without warning.

Kliënte word aangeraai om alle elektriese installasies vir die volle duur van die onderbreking as lewendig te beskou aangesien die elektrisiteitstoevoer ter engie tyd sonder waarskuwing herstel kan word.

Abathengi bacetyiswa ukuba zonke izixhobo zombane bazithathe njengezisebenzayo ngalo lonke ixesha umbane uphazamisekile njengoko ubonelelo ngombane lunokubuyiselwa kwakhona nangaliphi na ixesha ngaphandle kokulumkiswa.

WEATHER PERMITTING

NOTE: Please put your GEYSER SWITCH in the "OFF" position when the electricity goes off and switch it on again 1 hour after the electricity is restored. This will prevent unwanted tripping that may prolong your inconvenience.

CUSTOMER SUPPORT: 0860 103 089

NOTE: Please be aware that besides the 'WEATHER PERMITTING' other factors could postpone work. You may confirm operational status after 1 hour.

PP [Signature] N. DRAMAT



**CITY OF CAPE TOWN
ISIXEKO SASEKAPA
STAD KAAPSTAD**

Contact Person:
Kontakpersoon:
Umntu woqhagamshelwano:

**DEPOT MANAGER: Noogh Dramat
021 400 4649**

Telephone No:
Telefoon No.:
Umnxeba:

**CALL CENTRE: 0860 103 089
Ref: 6390/2022 – DbnS/sh**

**INTERRUPTION TO ELECTRICITY SUPPLY
ONDERBREKING IN ELEKTRISITEITSTOEVOER
UPHAZAMISEKO KUBONELELO NGOMBANE**

The electricity supply to:
Die elektrisiteitstoevoer na:
Ubonelelo ngombane kwezi ndawo:

**GIBSON SS, Gibson, Abingdon, Marlo, Sheerness
and Blackheath Roads, Bolus Ave, Ascot Rd,
KENILWORTH**

Will be interrupted on:
Sal onderbreek word op:
Luzakuphazamiseka ngomhla:

TUESDAY: April 26, 2022

From:
Vanaf:
Ukususela:

09h00

To:
Tot:
Ukuya:

16h00

The interruption is required for:
Die onderbreking is nodig vir:
Olu phazamiseko luyimfuneko ukuze:

**MEDIUM VOLTAGE: switchgear
maintenance**

Customers are advised to treat all electricity installations as live for the full duration of the interruption as the electricity supply may be restored at any time without warning.

Kliënte word aangeraai om alle elektriese installasies vir die volle duur van die onderbreking as lewendig te beskou aangesien die elektrisiteitstoevoer ter engie tyd sonder waarskuwing herstel kan word.

Abathengi bacetyiswa ukuba zonke izixhobo zombane bazithathe njengezisebenzayo ngalo lonke ixesha umbane uphazamisekile njengoko ubonelelo ngombane lunokubuyiselwa kwakhona nangaliphi na ixesha ngaphandle kokulumkiswa.


WEATHER PERMITTING

NOTE: Please put your GEYSER SWITCH in the "OFF" position when the electricity goes off and switch it on again 1 hour after the electricity is restored. This will prevent unwanted tripping that may prolong your inconvenience.

CUSTOMER SUPPORT: 0860 103 089

NOTE: Please be aware that besides the 'WEATHER PERMITTING' other factors could postpone work. You may confirm operational status after 1 hour.

PP [Signature] N. DRAMAT

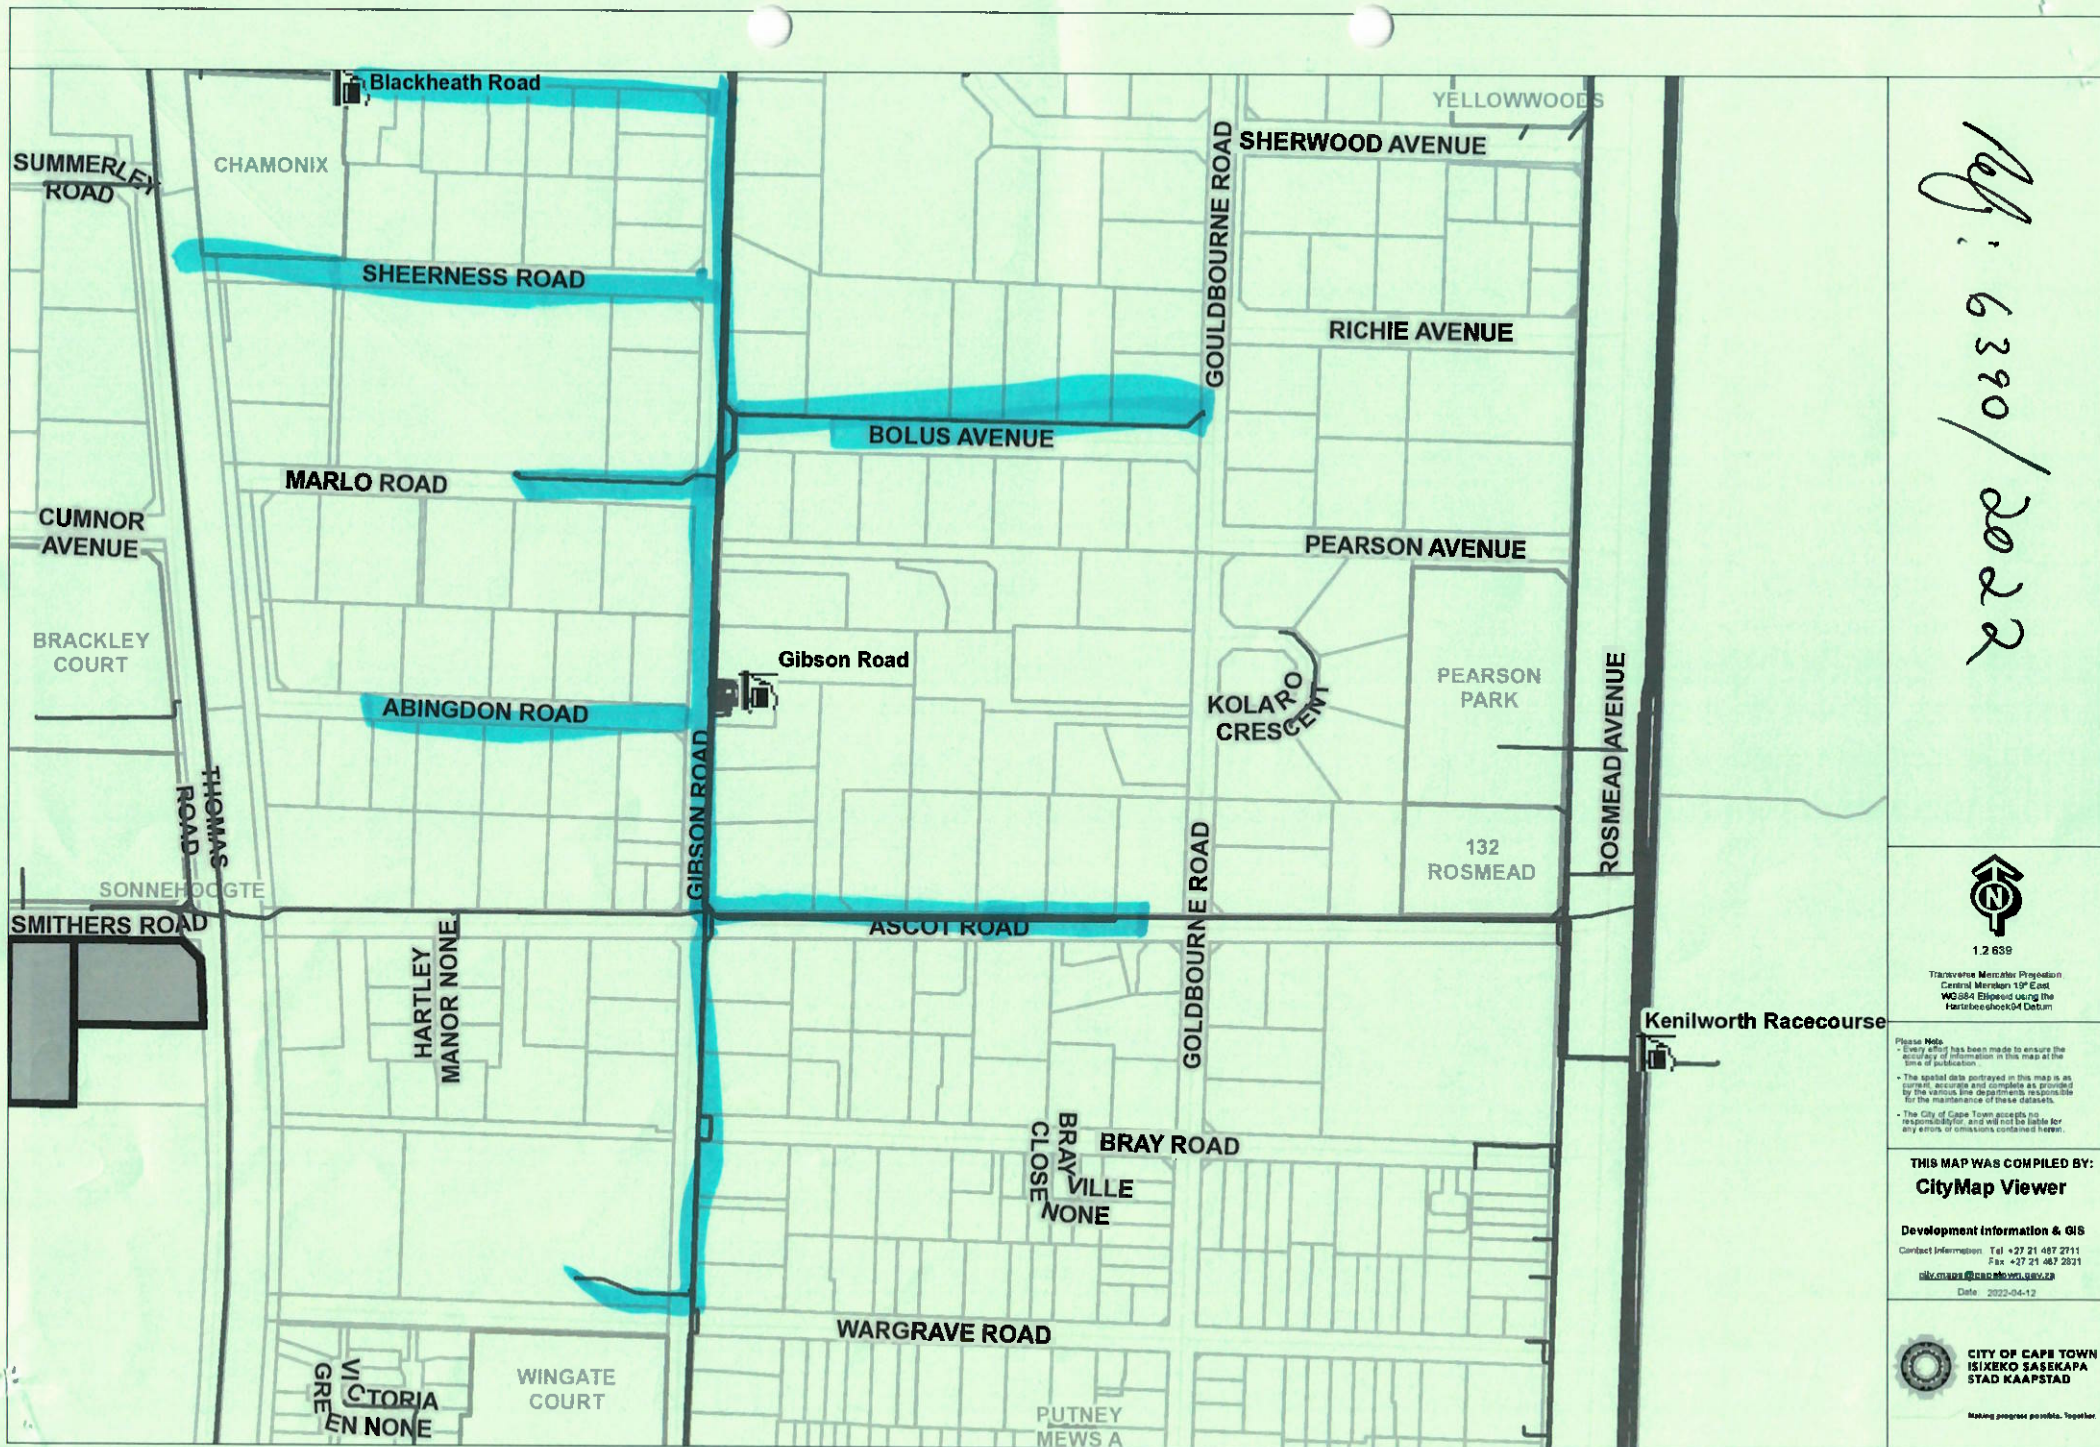

Ref: 6390/2022



1:2 659

Transverse Mercator Projection
Central Meridian 19° East
WGS84 Ellipsoid using the
Hershey's Datum

Please Note:
- Every effort has been made to ensure the accuracy of information in this map at the time of publication.
- The spatial data portrayed in this map is as current, accurate and complete as provided by the various line departments responsible for the maintenance of these datasets.
- The City of Cape Town accepts no responsibility for, and will not be liable for, any errors or omissions contained herein.

THIS MAP WAS COMPILED BY:
CityMap Viewer

Development Information & GIS
Contact Information: Tel: +27 21 487 2711
Fax: +27 21 487 2721
citymaps@capetown.gov.za
Date: 2022-04-12



CITY OF CAPE TOWN
ISIXEKO SASEKAPA
STAD KAAPSTAD

Making progress possible. Together